TN403

CUTTABLE HIDDEN WARDROBE ADJUSTERS

Ø35

1 PCS ADJUSTER STEEL BAR
2 PCS EXTERNAL ZAMAK HOUSINGS

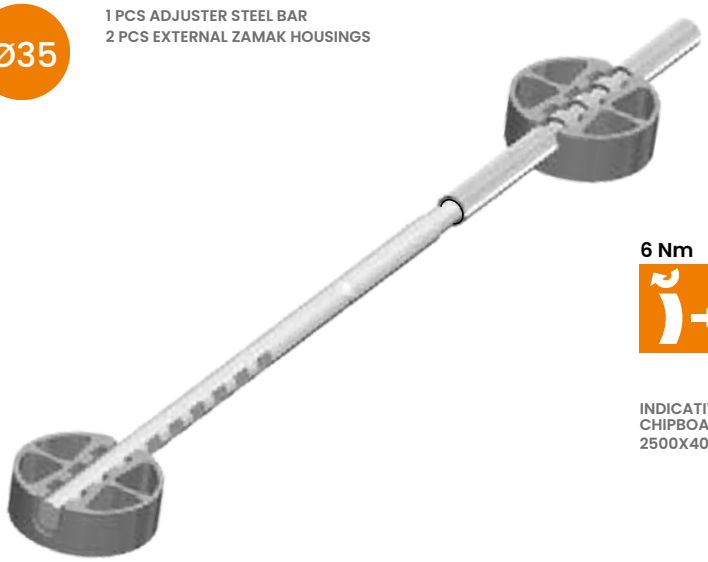

6 Nm → 35 N

INDICATIVE TEST ON CHIPBOARD PANEL 2500X400X20

6 Nm → 95 N

INDICATIVE TEST ON CHIPBOARD PANEL 2500X400X28

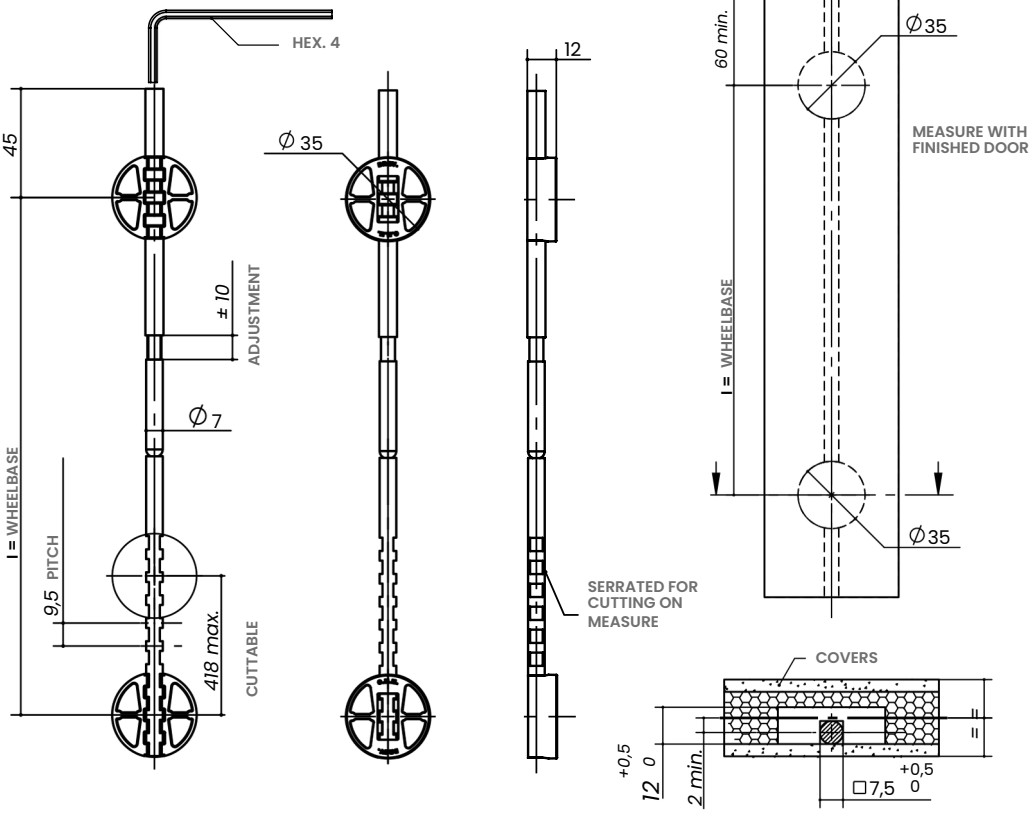

Normally used on hollow wood panels. Minimum thickness 18-20, depending on the thickness of the cover, see fig. 1.

Single and double adjustment. Centre distance min. 1200, max. 2800.

ACCESORIES



HEX. KEY 4